

March 4, 2024
 MERLY HUA BE FAMILY ASSOCIATON
 904 3rd floor G.Masangkay St. Brgy 296 Binondo Manila
 0956-4076325
merlinagawdia@gmail.com

| | |
|------------------------|------------|
| MODEL | Qty |
| KLG-IF70-5G1M32 | 3 |

OPTION 1- OUTDOOR AT THE BACK

| | | |
|--------------------|-------------|----------------|
| EVENTS HALL | Area | 170 sqm |
|--------------------|-------------|----------------|

ACU 1 7.0 HP Floor Standing Inverter **KLG-IF70-5G1M32**

Estimated Pipe Length = 10 ft
 Estimated Royal Cord Length = 17 ft

Initial Charge ₱ 14,000.00

Includes:
 Labor
 10ft Copper Tube
 10ft Royal Cord
 Indoor Bracket (Floor)
 Consumables

| Installation Materials | Description | Qty | Price per qty | Subtotal |
|----------------------------|-------------|--------|---------------|-------------------|
| Royal Cord (comm. wire) | 2.mm2 x 4C | 7 ft | ₱ 100.00/ft | ₱ 700.00 |
| Royal Cord (ACCU-Breaker) | 5.5mm x 3c | 7 ft | ₱ 70.00/ft | ₱ 490.00 |
| Circuit Breaker waterproof | 60A / 1Ph | 1 pc/s | ₱ 1,000.00/pc | ₱ 1,000.00 |
| PVC blue | 3/4" x 10' | 3 pc/s | ₱ 150.00/pc | ₱ 450.00 |
| Drain Hose | White -1/2" | 7 ft | ₱ 25.00/ft | ₱ 175.00 |
| | | | | <u>₱ 2,815.00</u> |

| | |
|--------------------------|--------------------|
| Estimated Charges | ₱ 16,815.00 |
|--------------------------|--------------------|

ACU 2 7.0 HP Floor Standing Inverter **KLG-IF70-5G1M32**

Estimated Pipe Length = 10 ft
 Estimated Royal Cord Length = 17 ft

Initial Charge ₱ 14,000.00

Includes:
 Labor
 10ft Copper Tube
 10ft Royal Cord
 Indoor Bracket (Floor)
 Consumables

| Installation Materials | Description | Qty | Price per qty | Subtotal |
|----------------------------|-------------|--------|---------------|-------------------|
| Royal Cord (comm. wire) | 2.mm2 x 4C | 7 ft | ₱ 100.00/ft | ₱ 700.00 |
| Royal Cord (ACCU-Breaker) | 5.5mm x 3c | 7 ft | ₱ 70.00/ft | ₱ 490.00 |
| Circuit Breaker waterproof | 60A / 1Ph | 1 pc/s | ₱ 1,000.00/pc | ₱ 1,000.00 |
| PVC blue | 3/4" x 10' | 3 pc/s | ₱ 150.00/pc | ₱ 450.00 |
| Drain Hose | White -1/2" | 7 ft | ₱ 25.00/ft | ₱ 175.00 |
| | | | | <u>₱ 2,815.00</u> |

| | |
|--------------------------|--------------------|
| Estimated Charges | ₱ 16,815.00 |
|--------------------------|--------------------|

ACU 2 7.0 HP Floor Standing Inverter **KLG-IF70-5G1M32**


Estimated Pipe Length = 10 ft
 Estimated Royal Cord Length = 17 ft

Initial Charge ₱ 14,000.00

Includes:
 Labor
 10ft Copper Tube
 10ft Royal Cord
 Indoor Bracket (Floor)
 Consumables

| Installation Materials | Description | Qty | Price per qty | Subtotal |
|----------------------------|-------------|--------|---------------|-------------------|
| Royal Cord (comm. wire) | 2.mm2 x 4C | 7 ft | ₱ 100.00/ft | ₱ 700.00 |
| Royal Cord (ACCU-Breaker) | 5.5mm x 3c | 7 ft | ₱ 70.00/ft | ₱ 490.00 |
| Circuit Breaker waterproof | 60A / 1Ph | 1 pc/s | ₱ 1,000.00/pc | ₱ 1,000.00 |
| PVC blue | 3/4" x 10' | 3 pc/s | ₱ 150.00/pc | ₱ 450.00 |
| Drain Hose | White -1/2" | 7 ft | ₱ 25.00/ft | ₱ 175.00 |
| | | | | <u>₱ 2,815.00</u> |

| | |
|--------------------------|--------------------|
| Estimated Charges | ₱ 16,815.00 |
|--------------------------|--------------------|

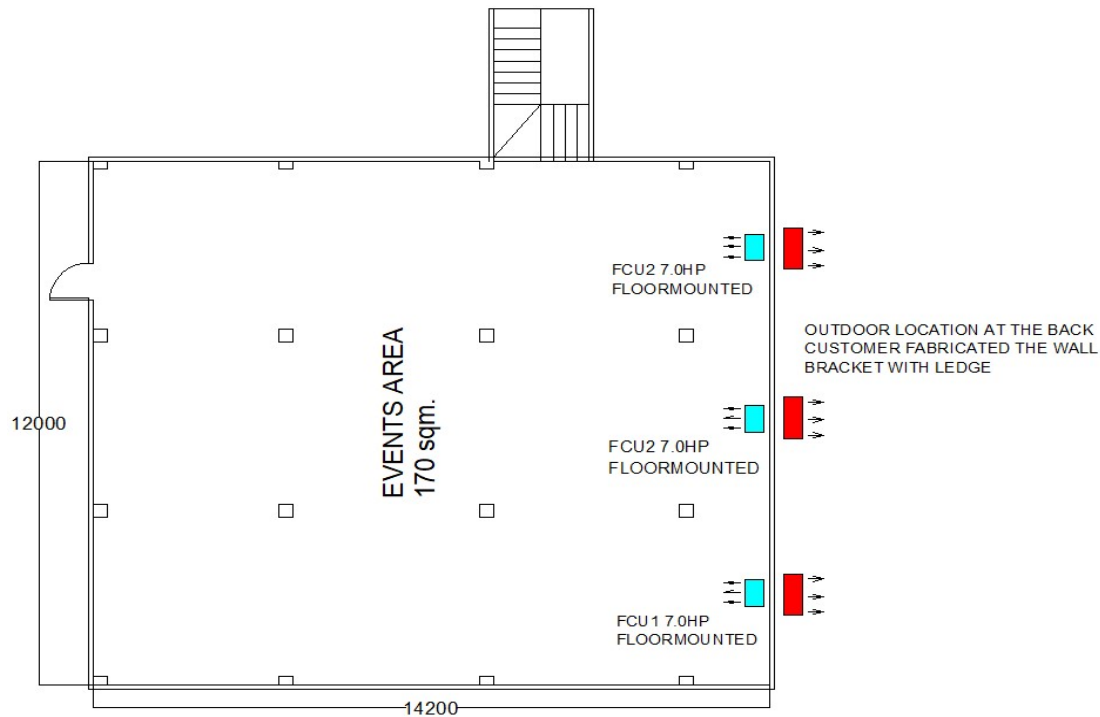

Total Estimated Charges

P 50,445.00

Validity: This quotation is valid for a period of fifteen (15) days from the date thereof, subject to our confirmation thereafter.

Installation notes:

- 1 Location of indoor and outdoor units are not yet final for confirmation. recommendation only
- 2 **Customer needs to provide fabricated outdoor bracket with ledge and service door for the outdoor location, each unit.**
- 3 **Need also to confirm the power source 3phase or 1phase. working days daytime only.**
- 4 **Working days: Monday to Saturday, 6 pax without parking Bring harness and rope.**
- 5 **Need for site visit for final location and units.**
- 6 Mechanical Plans, Permits, Electrical permits not included.
- 7 Deflectors, masonry, carpentry, chipping & plastering (finishing & restoration) are not included in the installation.
- 8 Air conditioning drain line and Electrical power supply (feeder line) **220v/ 60hz/ 1ph**, should be provided by customer's contractor.
- 9 **Final charges will be based on actual installation.**


Prepared by:

Customer Conformer:

Jeffrey Dadios
Field Surveyor

Signature Over Printed Name

Reviewed by:


Engr. Kenneth Zamora
Service Supervisor Shop and
Field Operation