


SITE SURVEY FORM

Customer's Name:
Address:
Contact Number:
Dealer / Branch:
Notification No.

CANILLO PEACH
B2, L10 ROXACO TOWNHOMES PANTALAN NASUGBU BATS.
0927-7538656

Date: 9/5/25

AIR CONDITIONED ROOM SCHEMATIC DRAWING

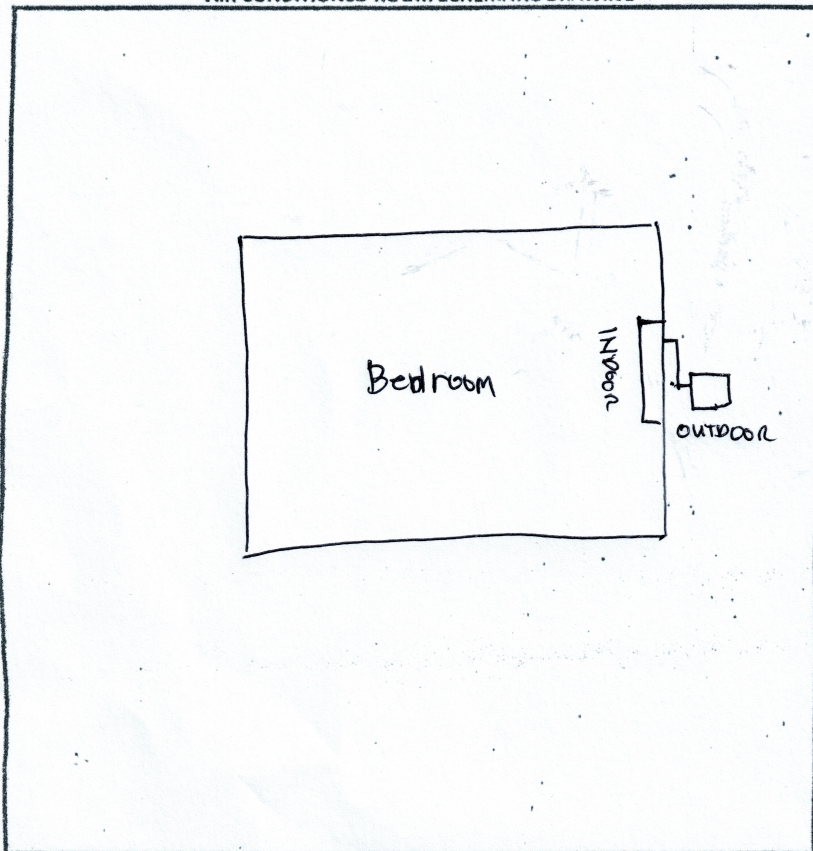

Details

Application
Location
Power Supply
Total Floor Area
Total Pipe Length
Pipe Length excess of 3m

Remarks

Bedroom
10.50m
10ft

Recommendation

Model
Unit Description
Capacity
SPLIT TYPE
1.0HP

INVERTER UNITS

FLOOR AREA COVERED	UNIT (HP)	MAX REF. PIPE LENGTH IDU-ODU
15 to 19 sqm.	1.0 HP	15 m
19 to 25 sqm.	1.5 HP	15 m
25 to 32 sqm.	2.0 HP	15 m
33 to 43 sqm.	2.5 HP	15 m

FLOOR AREA COVERED	UNIT (HP)	MAX HEIGHT IDU-ODU
15 to 19 sqm.	1.0 HP	7 m
19 to 25 sqm.	1.5 HP	7 m
25 to 32 sqm.	2.0 HP	10m
33 to 43 sqm.	2.5 HP	10m

OTHER DETAILS NEEDED:

- Type of unit.
- Location and access of unit (indoor and outdoor), free for installation.
- Location and access of unit (indoor and outdoor), free for servicing.
- Location of refrigerant lines.
- Need chipping works.
- Need for working permit/s.
- No. of personnel needed for the installation.
- Type of bracket for the outdoor unit. ☐ Box Type (Std.)
- Availability of Feeder Line.
- Availability of Electrical Circuit Breaker.
- Rating of Electrical Circuit Breaker (Amps.)
- With existing unit/s to be dismantled prior to installation of unit/s.

- ☒ Brand New ☐ Used
☒ Yes ☐ No
☒ Yes ☐ No
☒ Exposed ☐ Concealed
☒ Yes, ☐ No
☐ Yes ☒ No
3 persons
☒ L Type (Std.) ☐ Special
☒ Yes ☐ No
☒ Yes ☐ No
15A ☐ Yes ☒ No

REMARKS

Recommendation:
1.0HP

EXCLUSIONS:

- Concrete chipping, glass cutting and wall plastering.
- Electrical Circuit Breaker and power connection from breaker to main power source (Feeder Line).

NOTE: Extra installation work required by the customer is subject to additional charges which will be determined during on site installation.

SURVEYED BY:

Bryan Pangilinan

MBJ Accredited Service Shop
Signature over printed name

CONFORME:

Customer's signature over printed name