

Customer Name: JSL BAWISTA Date: 6-10-24
 Address: 18 ONE BOXLEY PLACE COFFE #35 SJR No: 208890
 Establishment Type: Residential Area Surveyed: LIVING / DINING
 Commercial Area Surveyed: _____

Recommended Product Model: KLM-1C40-XX 1M 32

Cooling Capacity Computation

Floor Area: 41.3 sqm.
 Ceiling Height: 2.9 mtr.

note: add 20% per meter in excess of 3 meters in the initial cooling capacity computed.

Floor Area :	<u>41.3</u>	x	550 Btu/h	<u>22715</u>	Btu/h
Ceiling Height (excess of 3 mtrs.) :	_____	x	20%	_____	Btu/h
Window Direct Sunlight	_____	x	20% - 50%	<u>4573</u>	Btu/h
Total Cooling Capacity				<u>27288</u>	Btu/h

Add : Additional Heat Load

No. of Person	<u>8</u>	x	300 Btu/h	<u>2400</u>	Btu/h
No. of Ordinary Light (<40w)	<u>14</u>	x	200 Btu/h	<u>2800</u>	Btu/h
No. of Special Light (>40w)	_____	x	400 Btu/h	_____	Btu/h
No. of Refrigerator (< 6 cu.ft.)	_____	x	400 Btu/h	_____	Btu/h
No. of Refrigerator (> 6 cu.ft.)	_____	x	800 Btu/h	_____	Btu/h
No. of Cooking Range	_____	x	1500 Btu/h	_____	Btu/h
No. of Laptop Computer	_____	x	150 Btu/h	_____	Btu/h
No. of Desktop Computer <u>1</u>	<u>1</u>	x	400 Btu/h	<u>400</u>	Btu/h
No. of Printer	_____	x	500 Btu/h	_____	Btu/h
No. of Photocopier	_____	x	1000 Btu/h	_____	Btu/h
Total Cooling Capacity				<u>5600</u>	Btu/h
				<u>3.7</u>	
				<u>32858</u>	Btu/h

Recommended Cooling Capacity

Note : Compressor warranty will be reduced to _____ yr. if air-conditioner purchased is lower than the recommended cooling capacity or pipe lay-out is beyond the maximum allowable length.


Scope of Work Agreement

- | | | |
|-----------------------------------|---|--|
| 1. Copper tube lay-out | <input checked="" type="checkbox"/> Expose | <input type="checkbox"/> Embedded |
| 2. Chipping | <input type="checkbox"/> Included | <input checked="" type="checkbox"/> Not Included |
| 3. Fabricated Bracket | <input type="checkbox"/> Yes <input checked="" type="checkbox"/> Shop | Site <input type="checkbox"/> No |
| 4. Service Ledge | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |
| 5. Dismantling of existing Aircon | <input type="checkbox"/> Included | <input checked="" type="checkbox"/> Not Included |
| 6. Ducting | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |

Dimension : _____

- Plastering, carpentry and restoration works are to be done by the customer.
- Wiring of electrical supply from main panel to air-conditioning unit are to be done by the customer.
- Processing of mechanical plan, working permit, electrical permit are to be done by the customer.
- Other concern;

CUSTOMER NEED TO PROVIDE POWER SUPPLY AT THE OUTDOOR BRACKET.
WORKING DAYS: MONDAY - FRIDAY 8AM - 5PM.
WITHOUT PARKING NEED A PAX ON-SITE FABRICATION
INDOOR BRACKET OUTDOOR UNIT CAN BE SEEN AT THE WINDOW.

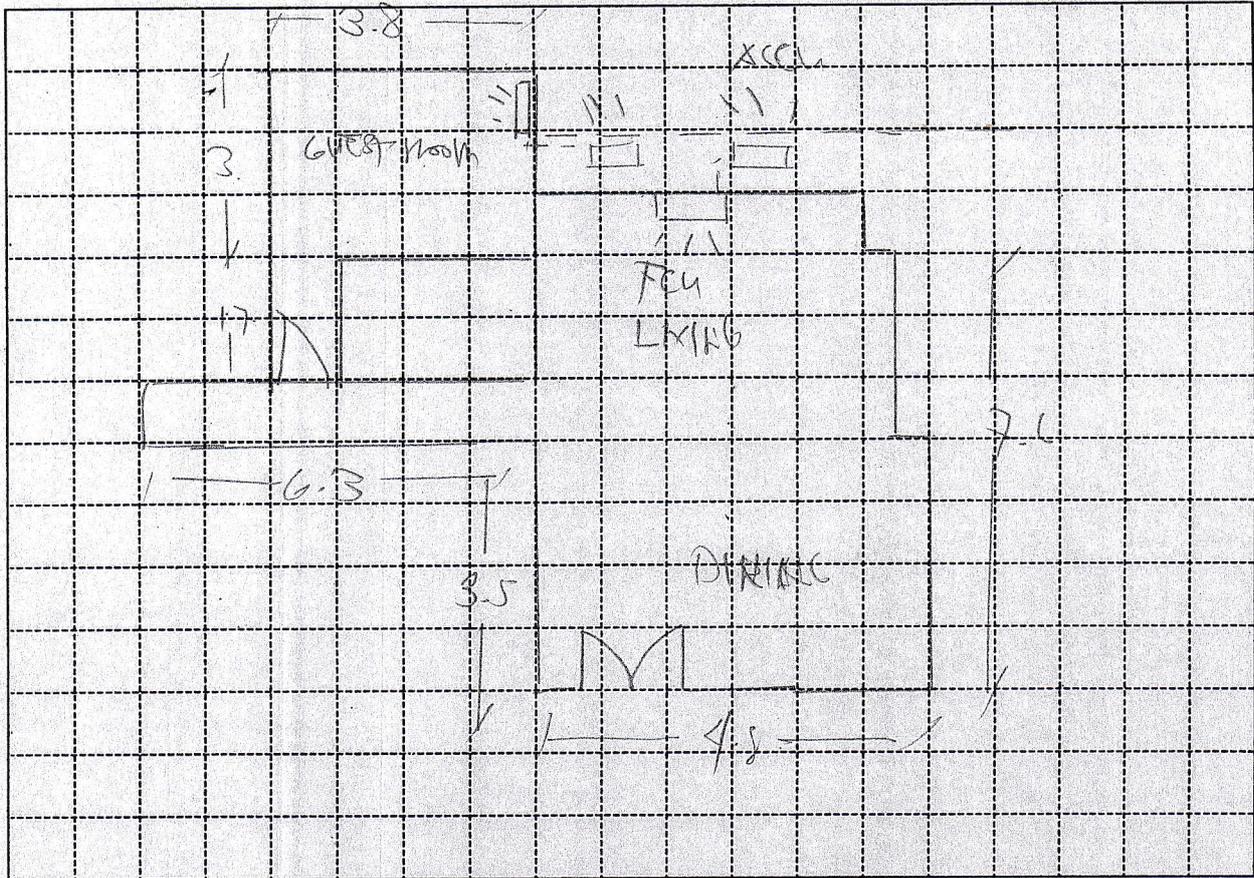

Indoor Unit Location : CENTER OF SPLIT LOWER OF WINDOW
 Outdoor Unit Location : AT THE BALCONY EDGE, BACK
 Pipe Length : 10 FT / 3 METERS
 Special Note : _____

Installation Cost Estimate			
Material Description	Qty.	Unit Cost	Total Cost
Copper Tube (excess of 10 ft.)	2330, 2430, 2520, (3520), 4620		
Wire (Royal Cord-signal wire) (excess of 10ft.)	2.0mmx4C	77	770
Wire (Royal Cord - Breaker to ODU)	3.5mm / 5.5mm x 3C	77	770
Circuit Breaker	20A, 30A, 40A/1ph, 40A/3ph	1	1000
Bracket (ODU) <u>GUARANTEED (WALL)</u>	(Imptd. / Fabricated) : (Floor / Wall)	1	1650
Bracket (WAC) <u>INDOOR WALL FABRICATED</u>	Angle Type	1	1500
PVC Pipe (drain)	1/2" / 3/4"	1	150
PVC Pipe (electrical)	3/4" , 1"		
Drain Pump			
Drain Pump Hose <u>WATER 1/2"</u>		77	175
Chipping Works	mtr.		
Dismantling Fee (existing air-conditioner)			
Initial Charge			12000
TOTAL ESTIMATE		P 17,665-	

- Note :
1. Initial Charge includes labor, 10ft. Copper tube, 10ft. Royal cord, Circuit breaker, Outdoor Bracket (SAC), Indoor Bracket (PAC) and Consumable materials.
 2. Survey fee will be **deducted** in the installation fee.

Prepared by:

 Signature Over Printed Name
JEOPPEY DOPS

Customer Conforme:

 Signature Over Printed Name
G. BAUTISTA