



April 14, 2025

TOMITA INDUSTRIAL & MACHINERY, INC.
#22 5/F TOYOMA GROUP CENTER, TIMOG AVE. BRGY. LAGING HANDA, QUEZON CITY
TEL#: 0923-0825868 / 0917-7205336

Dear Ma'am/Sir,

Kolin Marketing Inc., is extremely honored for your endorsement of Kolin brand and we are please to offer you with a special price/s for the following items.

A. EQUIPMENT & INSTALLATION

QTY	U/M	MODEL / DESCRIPTION	SRP	DISCOUNTED PRICE		AMOUNT
1	UNIT/S	MODEL: KLG-IF40-5G1M32 KOLIN FLOOR MOUNTED AIRCONDITIONER 37,980 Kj/h (3.0TR) FULL DC INVERTER R-32 SINGLE PHASE	113,195.00	79,028.20	PHP	79,028.20
TOTAL UNIT COST						PHP 79,028.20
ESTIMATED COST OF INSTALLATION (please see attached)						PHP 32,795.00
OTHERS: DELIVERY CHARGE						PHP 600.00
TOTAL ESTIMATED COST OF THE PROJECT						PHP 112,423.20

TERMS OF PAYMENT:

FULL PAYMENT OF UNIT AND DELIVERY CHARGE. IF CHECK, SUBJECT FOR 3 DAYS CLEARING.

WARRANTY:

FOR FLOOR MOUNTED: ONE (1) YEAR FREE PARTS AND LABOR, FIVE (5) YEARS WARRANTY ON COMPRESSOR.

NOTES: PRICES ARE SUBJECT TO CHANGE WITHOUT PRIOR NOTICE.

PRICES IS VAT INCLUSIVE.

*** Cost of Installation is Package with the Unit(s), this cost cannot avail separately (cost will be based on actual).*

We thank you for giving opportunity to offer our product and services, hoping we receive your purchase order.

If you need assistance, don't hesitate to call the under signed at 0917-807-8607 or email at kmi_asst@kolinphil.com.ph

Very Truly Yours,

JANELLEN S. LIM
KMI-ASSISTANT


Noted by:
MART NATHANIEL R. FLORES
KMI-SUPERVISOR

Approved By:
MS. EDITHA M. FLORES
AVP - FINANCE

KMI-QUOTE-04-25-0281
ECY-24%/7K

Conforme:

SIGNATURE OVER PRINTED NAME

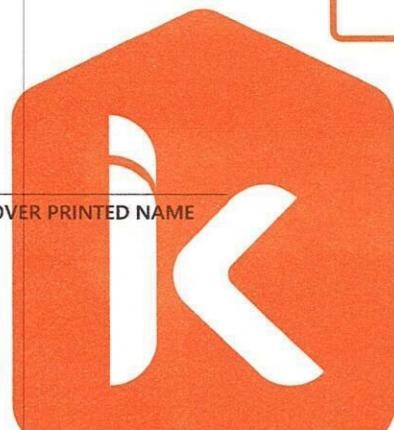

KOLIN Philippines International Inc.
Survey Form

No 003623

Customer Name: TO'MIX INDUSTRIAL
Address: #S/F RYAN'S, GULAP CENTRAL, TING, BAGUIO CITY, 26100 HANDBAG, PHILIPPINES
Establishment Type: Residential
Commercial
Area Surveyed: _____
Area Surveyed: _____
Date: 4-12-18
SJR No.: 144844

Recommended Product Model: KLG-1FZL0-C61V32

Cooling Capacity Computation

Floor Area: 30 sqm.
Ceiling Height: 2.7 mtr.

note: add 20% per meter in excess of 3 meters in the initial cooling capacity computed.

Floor Area:	<u>30</u>	x	550 Btu/h	<u>16,500</u> Btu/h
Ceiling Height (excess of 3 mtrs.):		x	20%	<u>3300</u> Btu/h
Window Direct Sunlight:		x	20% - 50%	<u>8250</u> Btu/h
Total Cooling Capacity				<u>27,750</u> Btu/h

Add : Additional Heat Load

No. of Person	<u>7</u>	x	300 Btu/h	<u>2100</u> Btu/h
No. of Ordinary Light (<40w)	<u>12</u>	x	200 Btu/h	<u>2400</u> Btu/h
No. of Special Light (>40w)		x	400 Btu/h	<u>800</u> Btu/h
No. of Refrigerator (< 6 cu.ft.)		x	400 Btu/h	<u>800</u> Btu/h
No. of Refrigerator (> 6 cu.ft.)		x	800 Btu/h	<u>1600</u> Btu/h
No. of Cooking Range		x	1500 Btu/h	<u>1500</u> Btu/h
No. of Laptop Computer		x	150 Btu/h	<u>225</u> Btu/h
No. of Desktop Computer	<u>1</u>	x	400 Btu/h	<u>400</u> Btu/h
No. of Printer	<u>1</u>	x	500 Btu/h	<u>500</u> Btu/h
No. of Photocopier		x	1000 Btu/h	<u>1000</u> Btu/h
Total Cooling Capacity				<u>6,600</u> Btu/h

Recommended Cooling Capacity

31,350 Btu/h


Note : Compressor warranty will be reduced to ____ yr. if air-conditioner purchased is lower than the recommended cooling capacity or pipe lay-out is beyond the maximum allowable length.

Scope of Work Agreement

1. Copper tube lay-out	<input checked="" type="checkbox"/> Expose	<input type="checkbox"/> Embedded
2. Chipping	<input type="checkbox"/> Included	<input checked="" type="checkbox"/> Not Included
3. Fabricated Bracket	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> Shop
4. Service Ledge	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> Site
5. Dismantling of existing Aircon	<input checked="" type="checkbox"/> Included	<input type="checkbox"/> No
6. Ducting	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> Not Included
		<input type="checkbox"/> No

Dimension :

7. Plastering, carpentry and restoration works are to be done by the customer.
8. Wiring of electrical supply from main panel to air-conditioning unit are to be done by the customer.
9. Processing of mechanical plan, working permit, electrical permit are to be done by the customer.
10. Other concern: DISMANTLE EXISTING AIRCON, CONNECT WIRE, PROVIDE POWER SOURCE.
POWER CORD AND POWER SWITC
INDIV. POWER CORD IN METER LENGTH, SAME
OF EXISTING 3.5M X 1.5M X 1.5M
CUSTOMER PROVIDE POWER SOURCE.
EXISTING SPLIT AC: 3/8 X 1/2 - 4 GIPS

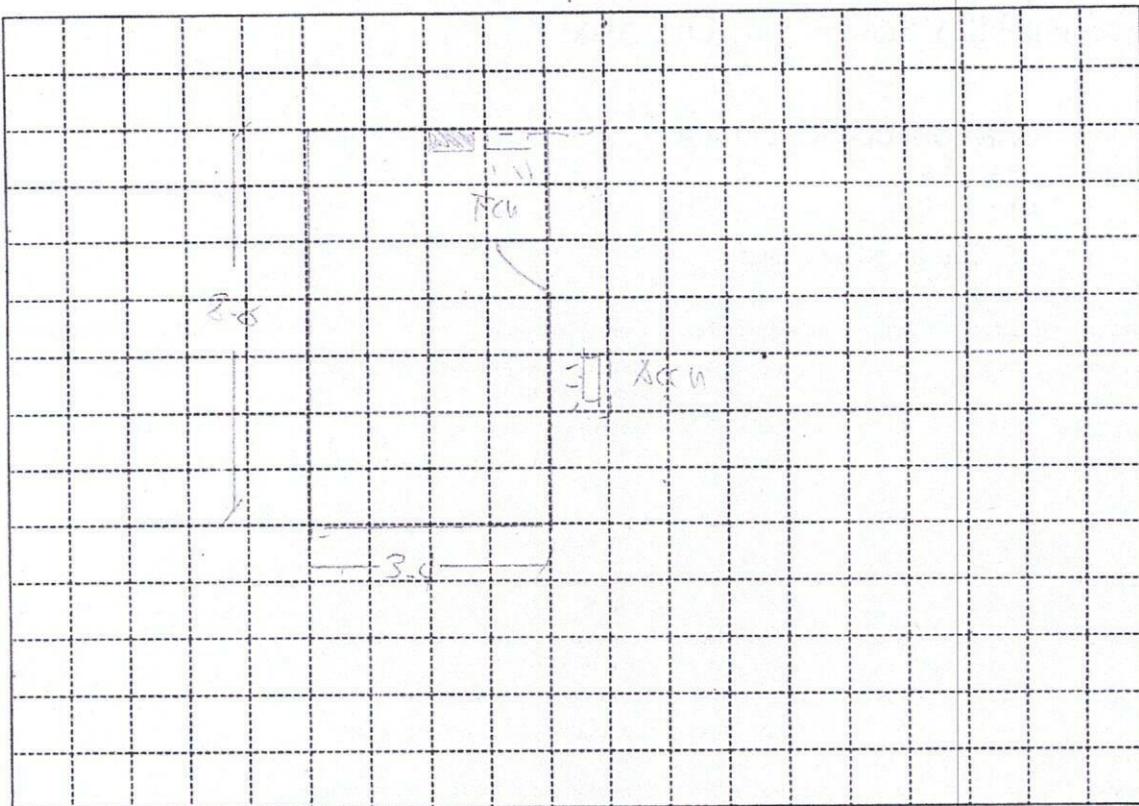

Indoor Unit Location : RIGHT SIDE OF COLUMN, SAME FLOOR

Outdoor Unit Location : DOF OF CP, SAVAN LOCATION

Pipe Length : 40 FT

Special Note

Installation Cost Estimate

Material Description	Qty.	Unit Cost	Total Cost
Copper Tube (excess of 10 ft.)	2330, 2430, 2520, 3520, 4620	400	12000
Wire (Royal Cord-signal wire) (excess of 10ft.)	2.0mmx4C	750	1500
Wire (Royal Cord - Breaker to ODU)	3.5mm / 5.5mm x 3C	60	420
Circuit Breaker	20A, 30A, 40A/1ph; 40A/3ph	1000	1000
Bracket (ODU)	(Imptd. / Fabricated); (Floor / Wall)		400
Bracket (WAC)	Angle Type		
PVC Pipe (drain)	1/2", 3/4"		
PVC Pipe (electrical)	3/4", 1"		
Drain Pump			
Drain Pump Hose	WHITE 1/2	75	75
Chipping Works	mtr.		
Dismantling Fee (existing air-conditioner)	3750 / FLOOR	35000	35000
Initial Charge			1000
TOTAL ESTIMATE			P 32,795/-

Note :

Note :

1. Initial Charge includes labor, 10ft. Copper tube, 10ft. Royal cord, Circuit breaker, Outdoor Bracket (SAC), Indoor Bracket (PAC) and Consumable materials.
2. Survey fee will be deducted in the installation fee.

Prepared by:

Signature Over Printed Name

Customer Conformance

RACHEL BHEN 4/12/25
Signature Over Printed Name