



February 19, 2026

SUPREME CARE MEDICAL DIAGNOSTIC CENTER
92 CLAUDIO ST., BRGY. SAN JUAN, MORONG RIZAL
TEL#: 0917-5030232

Dear Ma'am/Sir,

Kolin Marketing Inc., is extremely honored for your endorsement of Kolin brand and we are please to offer you with a special price/s for the following items.

A. EQUIPMENT & INSTALLATION - **OPTION 2**

QTY	U/M	MODEL / DESCRIPTION	SRP	DISCOUNTED PRICE		AMOUNT
1	UNIT/S	MODEL: KSG-IWF-15Wfy-8K1M32 KOLIN WALL MOUNTED PRIMUS GOLD AIRCONDITIONER 12,960 Kj/h (1.5HP) FULL DC INVERTER W/ WIFI R-32	46,595.00	28,412.20	PHP	28,412.20
1	UNIT/S	MODEL: KSG-IWF-25Wfy-8K1M32 KOLIN WALL MOUNTED PRIMUS GOLD AIRCONDITIONER 25,560 Kj/h (2.5HP) FULL DC INVERTER W/ WIFI R-32	68,995.00	45,436.20	PHP	45,436.20
TOTAL UNIT COST					PHP	73,848.40
ESTIMATED COST OF INSTALLATION (please see attached)					PHP	50,050.00
OTHERS: DELIVERY CHARGE					PHP	600.00
TOTAL ESTIMATED COST OF THE PROJECT					PHP	124,498.40

TERMS OF PAYMENT:

FULL PAYMENT OF UNIT AND DELIVERY CHARGE. IF CHECK, SUBJECT FOR 3 DAYS CLEARING.

BANK DETAILS:

- ** You may settle first payment for unit/s & delivery. Installation payment can be settled directly to installer after actual works.
- * Unit/s & Delivery: Account Name - KOLIN MARKETING INC. / Account# - 011808002307 (BDO-KALAYAAN)
- * Installation: Will be provided by assigned installer.

WARRANTY:

FOR SPLIT TYPE : ONE (1) YEAR FREE PARTS AND LABOR, THREE YEARS (3) MAIN PCB , TEN (10) YEARS WARRANTY ON COMPRESSOR.

NOTES: PRICES ARE SUBJECT TO CHANGE WITHOUT PRIOR NOTICE.

PRICES IS VAT INCLUSIVE.

** Cost of Installation is Package with the Unit(s), this cost cannot avail separately (Final charges will be based on actual works).

We thank you for giving opportunity to offer our product and services, hoping we receive your purchase order.
If you need assistance, don't hesitate to call the under signed at 0917-807-8607 or email at kmi_asst@kolinphil.com.ph

Very Truly Yours,

JANELLEN S. LIM
KMI-ASSISTANT

Noted by:

MART NATHANIEL R. FLORES
KMI-SUPERVISOR

Approved By

MS. EDITHA M. FLORES
AVP - FINANCE

KMI-QUOTE-02-26-0065.2-rev
MMC-24%/7K

Conforme: _____
SIGNATURE OVER PRINTED NAME



JRA JERRICO

Refrigeration and Air-conditioning Services
 54, 19 Felixvill, Mangahan, Sto. Niño Bitibiran, Binangonan Rizal
 Email: jraairconditioning@gmail.com
 Contact Nos. 09267189004/09615215615

Survey Form

Customer Name: Supreme care medical diagnostic and imaging Date: 2/4/24
 Address: 92 claudis st. Brgy. San Juan Morong Rd SJR No.: HO-00889561
 Establishment Type: Residential: Area Surveyed: _____
 Commercial: Area Surveyed: Hallway/Entrance a Ramp
 Recommended Product Model: KSG-1WF-25WPKY-8KIM32

Cooling Capacity Computation

Floor Area :	<u>16.02</u> sqm.				
Ceiling Height :	<u>8.5</u> mtr.				
			note: add 20% per meter in excess of 3 meters in the initial cooling capacity computed.		
Floor Area :	<u>16.02</u>	x	550 Btu/h	<u>8811</u>	Btu/h
Ceiling Height (excess of 3 mtrs.):	<u>1</u>	x	20%	<u>1762</u>	Btu/h
Window Direct Sunlight		x	<u>20%</u> - 50%	<u>1762</u>	Btu/h
Total Cooling Capacity				<u>10573</u>	Btu/h
Add : Additional Heat Load					
No. of Person	<u>6</u>	x	300 Btu/h	<u>1800</u>	Btu/h
No. of Ordinary Light (<40w)	<u>8</u>	x	200 Btu/h	<u>1600</u>	Btu/h
No. of Special Light (>40w)		x	400 Btu/h		Btu/h
No. of Refrigerator (< 6 cu.ft.)		x	400 Btu/h		Btu/h
No. of Refrigerator (> 6 cu.ft.)		x	800 Btu/h		Btu/h
No. of Cooking Range		x	1500 Btu/h		Btu/h
No. of Laptop Computer		x	150 Btu/h		Btu/h
No. of Desktop Computer		x	400 Btu/h		Btu/h
No. of Printer		x	500 Btu/h		Btu/h
No. of Photocopier		x	1000 Btu/h		Btu/h
Total Cooling Capacity				<u>3400</u>	Btu/h
Recommended Cooling Capacity				<u>13973</u>	Btu/h

Note : Compressor warranty will be reduced to ___ yr. if air-conditioner purchased is lower than the recommended cooling capacity or pipe lay-out is beyond the maximum allowable length


Scope of Work Agreement

- | | | |
|-----------------------------------|--|--|
| 1. Copper tube lay-out | <input checked="" type="checkbox"/> Expose | <input type="checkbox"/> Embedded |
| 2. Chipping | <input type="checkbox"/> Included | <input checked="" type="checkbox"/> Not Included |
| 3. Fabricated Bracket | <input type="checkbox"/> Yes <input type="checkbox"/> Shop | <input type="checkbox"/> Site <input checked="" type="checkbox"/> No |
| 4. Service Ledge | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |
| 5. Dismantling of existing Aircon | <input checked="" type="checkbox"/> Included | <input type="checkbox"/> Not Included |
| 6. Ducting | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |

Dimension : _____

7. Plastering, carpentry and restoration works are to be done by the customer.
8. Wiring of electrical supply from main panel to air-conditioning unit are to be done by the customer
9. Processing of mechanical plan, working permit, electrical permit are to be done by the customer
10. Other concern:

1. Expose Drainline and Copper Pipe
2. Will use existing breaker
3. Existing unit in location is 1.5 hp

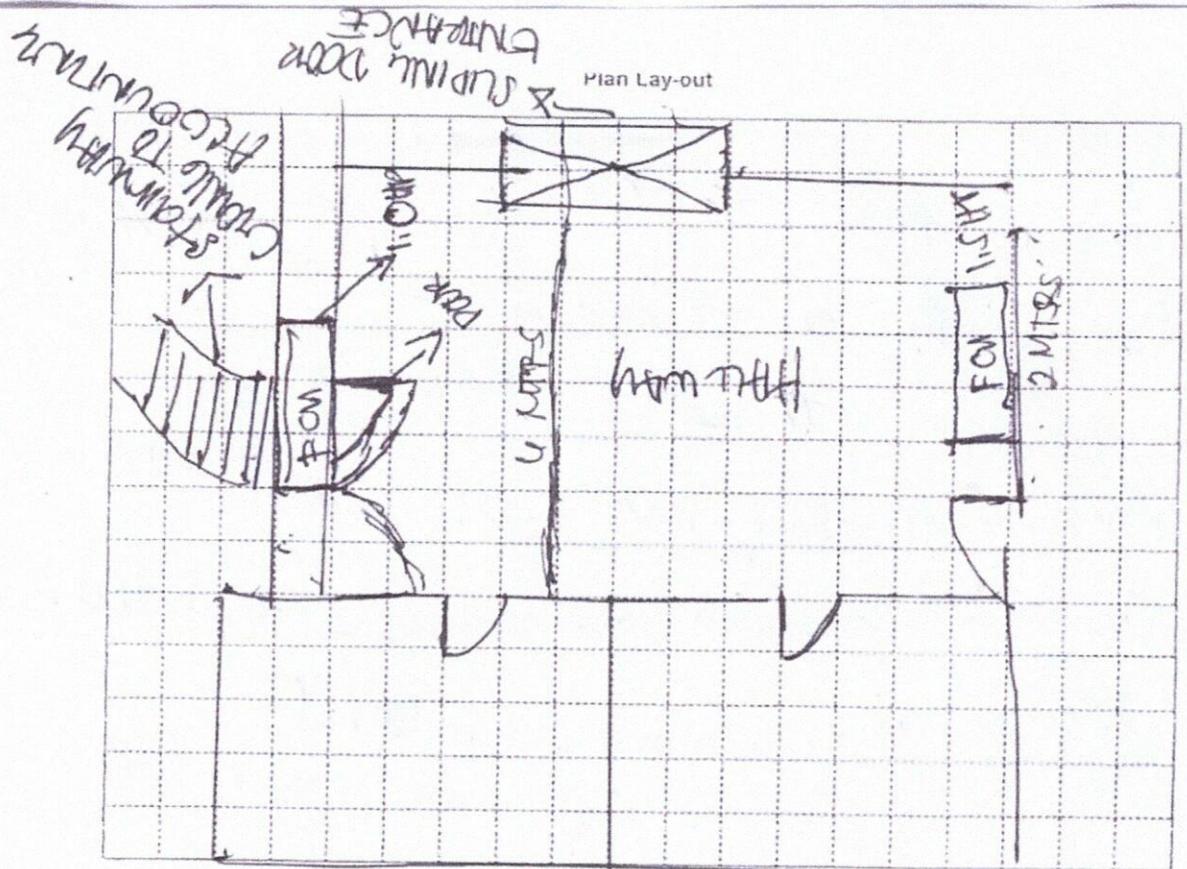


Indoor Unit Location Center of the room
 Outdoor Unit Location outside the room
 Pipe Length 41 Ft.
 Special Note _____

Installation Cost Estimate			
Material Description	Qty	Unit Cost	Total Cost
Copper Tube (excess of 10 ft)	2330, 2430, 2520, 3520, 4620		
Wire (Royal Cord - signal wire) (excess of 10ft)	2.5mmx4C	31 ft.	P 12,400
Wire (Royal Cord - Breaker to ODU)	3.5mm / 5.5mm x 3C	36 ft.	P 3,600
Circuit Breaker	20A, 30A, 40A/1ph, 40A/3ph	5 Pcs.	P 300
Bracket (ODU)	(Imptd / Fabricated) - (Floor / Wall)		
Bracket (WAC)	Angle Type		
PVC Pipe (drain)	1/2", 3/4"	3 pcs	P 450
PVC Pipe (electrical)	3/4", 1"		
Drain Pump			
Drain Pump Hose			
Chipping Works	mtr		
Dismantling Fee (existing air-conditioner)	1 unit	1500	1500
Initial Charge			8500
TOTAL ESTIMATE		P 726,750	

- Note :
- 1 Initial Charge includes labor, 10ft Copper tube, 10ft Royal cord, Circuit breaker, Outdoor Bracket (SAC), Indoor Bracket (PAC) and Consumable materials
 - 2 Survey fee will be deducted in the installation fee

Prepared by: 
 Signature Over Printed Name

Customer Conforme: _____
 Signature Over Printed Name

REVIEWED BY:

 02/07/2026
 ENGR. ADRIAN NOGOY
 PROJECT ENGINEER-KPII

JRA JERRICO

Refrigeration and Air-conditioning Services
 84, 1st Felicidad, Mandabao, Sto. Niño Silibiran, Binangonan Rizal
 Email: jra@jerrico.com.ph
 Contact Nos. 09267107004/09619218619

Survey Form

Customer Name: Supreme care Medical Diagnostic Date: 2/16/20
 Address: 92 Claudio St. Bay San Juan Morong Rizal SJR No: _____
 Establishment Type: Residential Area Surveyed: Scan room waiting area
 Commercial Area Surveyed: _____
 Recommended Product Model: KSG-1WF-15WF-8K1M33

Cooling Capacity Computation


Floor Area	<u>12.60</u> sqm			
Ceiling Height	<u>8.5</u> mtr	note: add 20% per meter in excess of 3 meters in the initial cooling capacity computed		
Floor Area	<u>12.60</u>	x	550 Btuh	<u>6930</u> Btuh
Ceiling Height (excess of 3 mtrs.)	<u>1</u>	x	20%	<u>1390</u> Btuh
Window Direct Sunlight		x	20% - 50%	<u>1390</u> Btuh
Total Cooling Capacity				<u>9710</u> Btuh
Add: Additional Heat Load				
No. of Person	<u>4</u>	x	300 Btuh	<u>1200</u> Btuh
No. of Ordinary Light (<40w)	<u>8</u>	x	200 Btuh	<u>1600</u> Btuh
No. of Special Light (>40w)		x	400 Btuh	
No. of Refrigerator (< 6 cu.ft.)		x	400 Btuh	
No. of Refrigerator (> 6 cu.ft.)		x	800 Btuh	
No. of Cooking Range		x	1500 Btuh	
No. of Laptop Computer		x	150 Btuh	
No. of Desktop Computer		x	400 Btuh	
No. of Printer		x	500 Btuh	
No. of Photocopier		x	1000 Btuh	
Total Cooling Capacity				<u>2880</u> Btuh
Recommended Cooling Capacity				<u>12510</u> Btuh

Note: Compressor warranty will be reduced to ___ yr. if air-conditioner purchased is lower than the recommended cooling capacity or pipe lay-out is beyond the maximum allowable length

Scope of Work Agreement

- | | | |
|----------------------------------|--|--|
| 1. Copper tube lay-out | <input checked="" type="checkbox"/> Expose | <input type="checkbox"/> Embedded |
| 2. Chipping | <input type="checkbox"/> Included | <input type="checkbox"/> Not Included |
| 3. Fabricated Bracket | <input type="checkbox"/> Yes <input type="checkbox"/> Shop | <input type="checkbox"/> Sec <input type="checkbox"/> No |
| 4. Service Ledge | <input type="checkbox"/> Yes | <input type="checkbox"/> No |
| 5. Dismantling of existing Aicon | <input checked="" type="checkbox"/> Included | <input type="checkbox"/> Not Included |
| 6. Ducting | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |


7. Plastering, carpentry and restoration works are to be done by the customer.
 8. Wiring of electrical supply from main panel to air-conditioning unit are to be done by the customer.
 9. Processing of mechanical plan, working permit, electrical permit are to be done by the customer.
 10. Other concern: Expose Drain line and copper pipe
Will use Existing Breaker

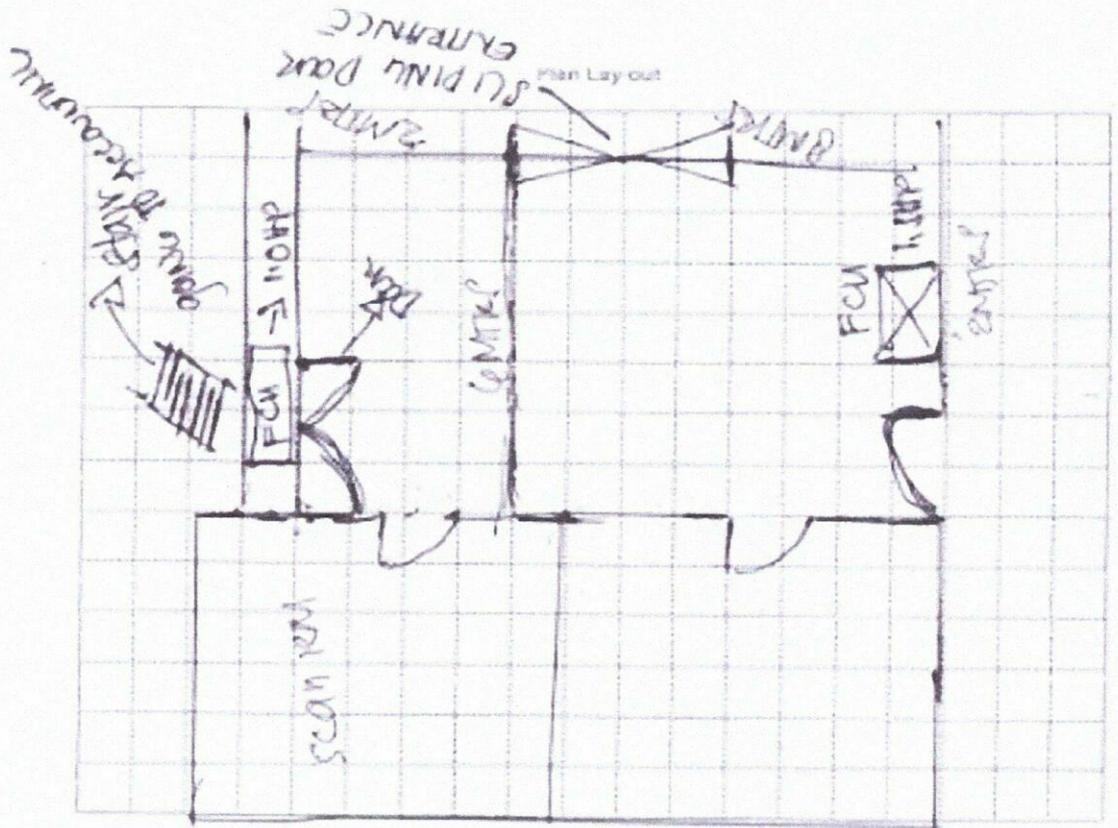

Indoor Unit Location: Center of the room upon Entering
 Outdoor Unit Location: Outside the room
 Pipe Length: 39 ft.
 Special Note: _____

Installation Cost Estimate			
Material Description	Qty	Unit Cost	Total Cost
Copper Tube (excess of 10 ft)	2330, 2430, 2520, 3520, 4620	2.97	7011.30
Wire (Royal Cord signal wire) (excess of 10 ft)	2 General	350.00	700.00
Wire (Royal Cord - breaker to ODU)	5 ft.	100.00	500.00
Circuit breaker	20A, 30A, 40A, 50A	50.00	200.00
Bracket (ODU)		\$1	
Bracket (IAC)			
PVC Pipe (400)	1/2", 3/4"	3.00	900.00
PVC Pipe (1/2")	3/4", 1"		
Drain Plug			
Drain Plug Plug			
Charger Valve			
Discharging Fee (existing air conditioner)	1 unit	1500.00	1500.00
Initial Charge			500.00
TOTAL ESTIMATE			\$13,200

- Note:
1. Initial Charge includes labor, 10ft. Copper tube, 10ft. Royal cord, Circuit breaker, Outdoor Bracket (SAC), Indoor Bracket (IAC) and Consumable materials.
 2. Survey fee will be deducted in the installation fee.

Prepared by: 
 Signature Over Printed Name

Customer Confirms: _____
 Signature Over Printed Name

REVIEWED BY:

 02/19/2026
 ENGR. ADRIAN MOGOY
 PROJECT ENGINEER RPI